## resideo



# Braukmann BA295STN-11/2A

## **Backflow Preventer**

for standpipes

#### **APPLICATION**

Backflow preventers of this type are suitable for the protection of drinking water systems against back pressure, backflow and back syphonage.

They are used to protect the temporary water tapping of standpipes on events or constructionsites.

Fluids up to and including liquid category 4 to EN 1717 are protected.

#### **APPROVALS**

DVGW

#### **SPECIAL FEATURES**

- Optimal protection of the drinking water supply system
- Integrated inlet strainer
- Inlet check valve and discharge valve are combined in one cartridge
- Minimal maintenance required, because the valve cartridge is completely replaceable
- Optimized design prevents water stagnation in normal operation
- Compact construction
- Easy access to all internal components
- Low pressure loss and high flow rate
- Triple security two check valves and a discharge valve separate the backflow preventer into three pressure zones
- Meets KTW recommendations for drinking water
- Each tapping can be protected separately



#### **TECHNICAL DATA**

| Media                              |   |  |  |
|------------------------------------|---|--|--|
| Medium:                            | Drinking water                          |  |  |
| Connections/Sizes                  |   |  |  |
| Connection size:                   | 11/2"                                   |  |  |
| Discharge pipe connection:         | DN40                                    |  |  |
| Pressure values                    |   |  |  |
| Inlet pressure:                    | 1.5 bar - 10 bar                        |  |  |
| Operating temperatures             |   |  |  |
| Max. operating temperature medium: | 65 °C                                   |  |  |
| Specifications                     |   |  |  |
| Installation position:             | Vertical with discharge valve downwards |  |  |

#### **CONSTRUCTION**



|  |   | Components  | Materials  |  |
|--|---|---|--|--|
|  | 1   | Two test sockets (Third is integrated in the optionally available blind plug) | Lead-free brass  |  |
|  | 2   | Integral shut-off and check valve on outlet                                   | _  |  |
|  |   |   | Lead-free brass  |  |
|  |   |   | Lead-free brass  |  |
|  |   | Not depicted components:  |  |  |
|  | Integral strainer, mesh size approx. 0.6 mm |   | Stainless steel  |  |
|  |   | Valve cartridge with integral check valve and discharge valve                 | High-quality synthetic material  |  |
|  |   | Outlet check valve  | High-quality synthetic<br>material and red bronze<br>shut-off facility with check<br>valve |  |
|  |   | Sealing elements  | Elastomer materials suitable for drinking water  |  |

#### **METHOD OF OPERATION**

BA type backflow preventers are divided into three pressure zones. The pressure in zone ① is higher than in zone ② , which in turn is higher than in zone ③ . A discharge valve is connected to zone ② which opens at the latest when the differential pressure between zones ① and ② drops to 0.14 bar. The water from zone ② discharges to atmosphere, both check valves close and therefore separate zone ② from zone ① and ③ . In this way the danger of back pressure or back syphonage into the supply network is prevented. The pipework connection is interrupted and the drinking water network is protected.

#### TRANSPORTATION AND STORAGE

Keep parts in their original packaging and unpack them shortly before use.

The following parameters apply during transportation and storage:

| Parameter                       | Value                    |
|---------------------------------|--------------------------|
| Environment:                    | clean, dry and dust free |
| Min. ambient temperature:       | 5 °C                     |
| Max. ambient temperature:       | 55 °C                    |
| Min. ambient relative humidity: | 25 % *                   |
| Max. ambient relative humidity: | 85 % *                   |


<sup>\*</sup>non condensing

## **INSTALLATION GUIDELINES**

## **Setup requirements**

- Thoroughly flush pipework before installing the backflow preventer
- The backflow preventer and the distributor head must be connected to one another non-detachably with an according to the local drinking water standards approved glue!
- Directly connected to distributor
- Backflow preventers of this type have an integral strainer which protects the device from the ingress of dirt. With highly polluted water a fine filter should be installed upstream to ensure the correct function of the device
- The installation location should be protected against frost
- In order to avoid flooding, it is recommended to arrange a permanent, professionally dimensioned wastewater connection
- These armatures need to be maintained regularly

## **Installation Example**

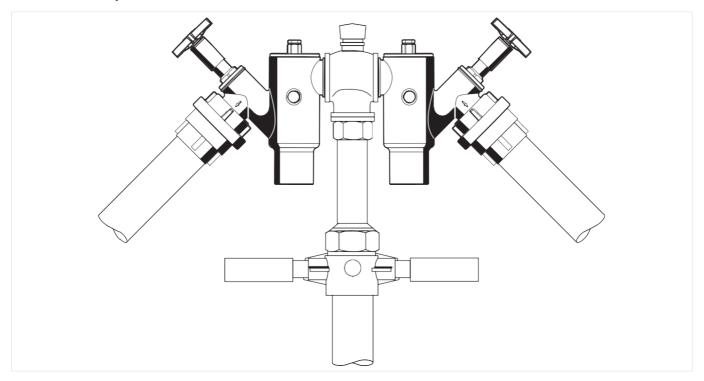

## **TECHNICAL CHARACTERISTICS**

#### **Pressure drop characteristics**


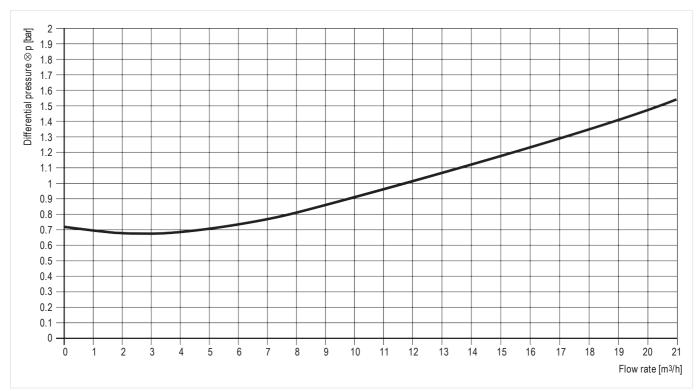


Fig. 1 Pressure drop within the valve in dependency of the flow rate and the used connection size

## **DIMENSIONS**

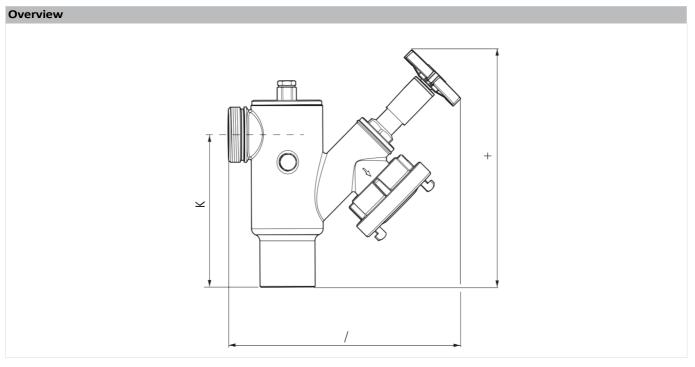

| Parameter                 |    | Values                                 |  |
|---------------------------|----|--|--|
| Connection size Inlet:    | R  | G2"                                    |  |
| Connection size Outlet:   | R  | C-Coupling                             |  |
| Nominal size:             | DN | 1 <sup>1</sup> / <sub>2</sub> " / DN40 |  |
| Weight:                   | kg | 3.8                                    |  |
| Dimensions:               | L  | 252                                    |  |
|                           | Н  | 255                                    |  |
|                           | h  | 165                                    |  |
| DVGW registration number: |    | DW-6365CN0098                          |  |

Note: All dimensions in mm unless stated otherwise.

## **ORDERING INFORMATION**

The following tables contain all the information you need to make an order of an item of your choice. When ordering, please always state the type, the ordering or the part number.

## **Options**

The backflow preventer is available in the following sizes:  $1^{1}/_{2}$ ".

- standard
- not available


|                  |  | BA295STN-11/2A |
|------------------|--|----------------|
| Connection type: | Standard version with C-coupling on outlet | •              |

## Accessories

|     | Description |   | Dimension | Part No.  |
|-----|-------------|---|-----------|-----------|
|     | TKA295      | Test kit  |           |           |
|     |             | Analogue pressure measuring device with differential pressure display. With case and accessories, ideal for inspection and maintenance of backflow preventer type BA. |           |           |
|     |             |   |           | TKA295    |
|     | BS295ST     | Blind plug C-coupling   |           |           |
|     | N           | With integrated test socket for checking standpipe-BA   |           |           |
|     |             |   |           | BS295STN- |
| - 6 |             |   |           | 11/2A     |

## **Spare Parts**

Backflow preventer BA295STN-A, from 2010 onwards

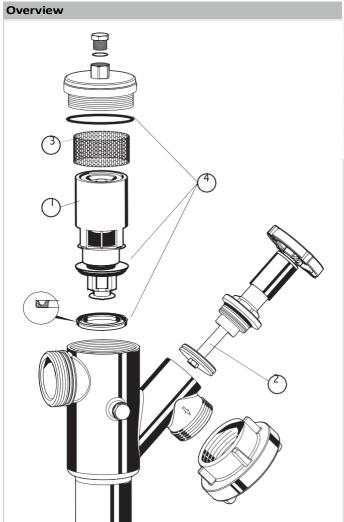

|   | Description                | Dimension                              | Part No.       |  |
|---|----------------------------|--|----------------|--|
| 1 | Cartridge insert complete* |  |                |  |
|   |                            | $1^{1}/_{2}$ " / DN40                  | 0903745        |  |
| 2 | Shut-off facility complete |  |                |  |
|   |                            | $1^{1}/_{2}$ " / DN40                  | AE295STN-11/2A |  |
| 3 | Sieve                      |  |                |  |
|   |                            | $1^{1}/_{2}$ " / DN40                  | S295STN-11/2   |  |
| 4 | Sealing set                |  |                |  |
|   |                            | 1 <sup>1</sup> / <sub>2</sub> " / DN40 | DS295STN-11/2  |  |

\* Wearing parts are excluded from warranty!